

D-Valves Ltd.
6133 -97 St.
Edmonton, Alberta T6E 3J3
Phone (780) 436-5353 Fax (780) 436-7653

We certify that all inside blow-out preventers, Kellycocks and valves supplied on the work order listed below, are manufactured to meet all requirements in accordance with :

American Petroleum Institute (A.P.I.)
National Association of Corrosion Engineers (NACE) MR-01-75 specifications
Alberta Recommended Practices (A.R.P.)

All valves have been pressure tested and charted.

Customer: Calibre Energy
Work Order # 56625
Serial # A107-003-IN


Date: January 25, 2007
Size: 2 9/16" Barton Flanged Gate Valve
Pressure: 5,000 PSI

Part	Number	Part	Number
Body	IRIS BA-353	Bonnet	IRIS BA-354
Gate	IRIS BA-355	Gate Segment	IRIS BA-356
Seat	H10400301PA	Seat	H10400301PA
Stem	84-17		

Authorized Signature:



Caliber Energy Systems
2 9/16 Barton Threaded Gate Valve

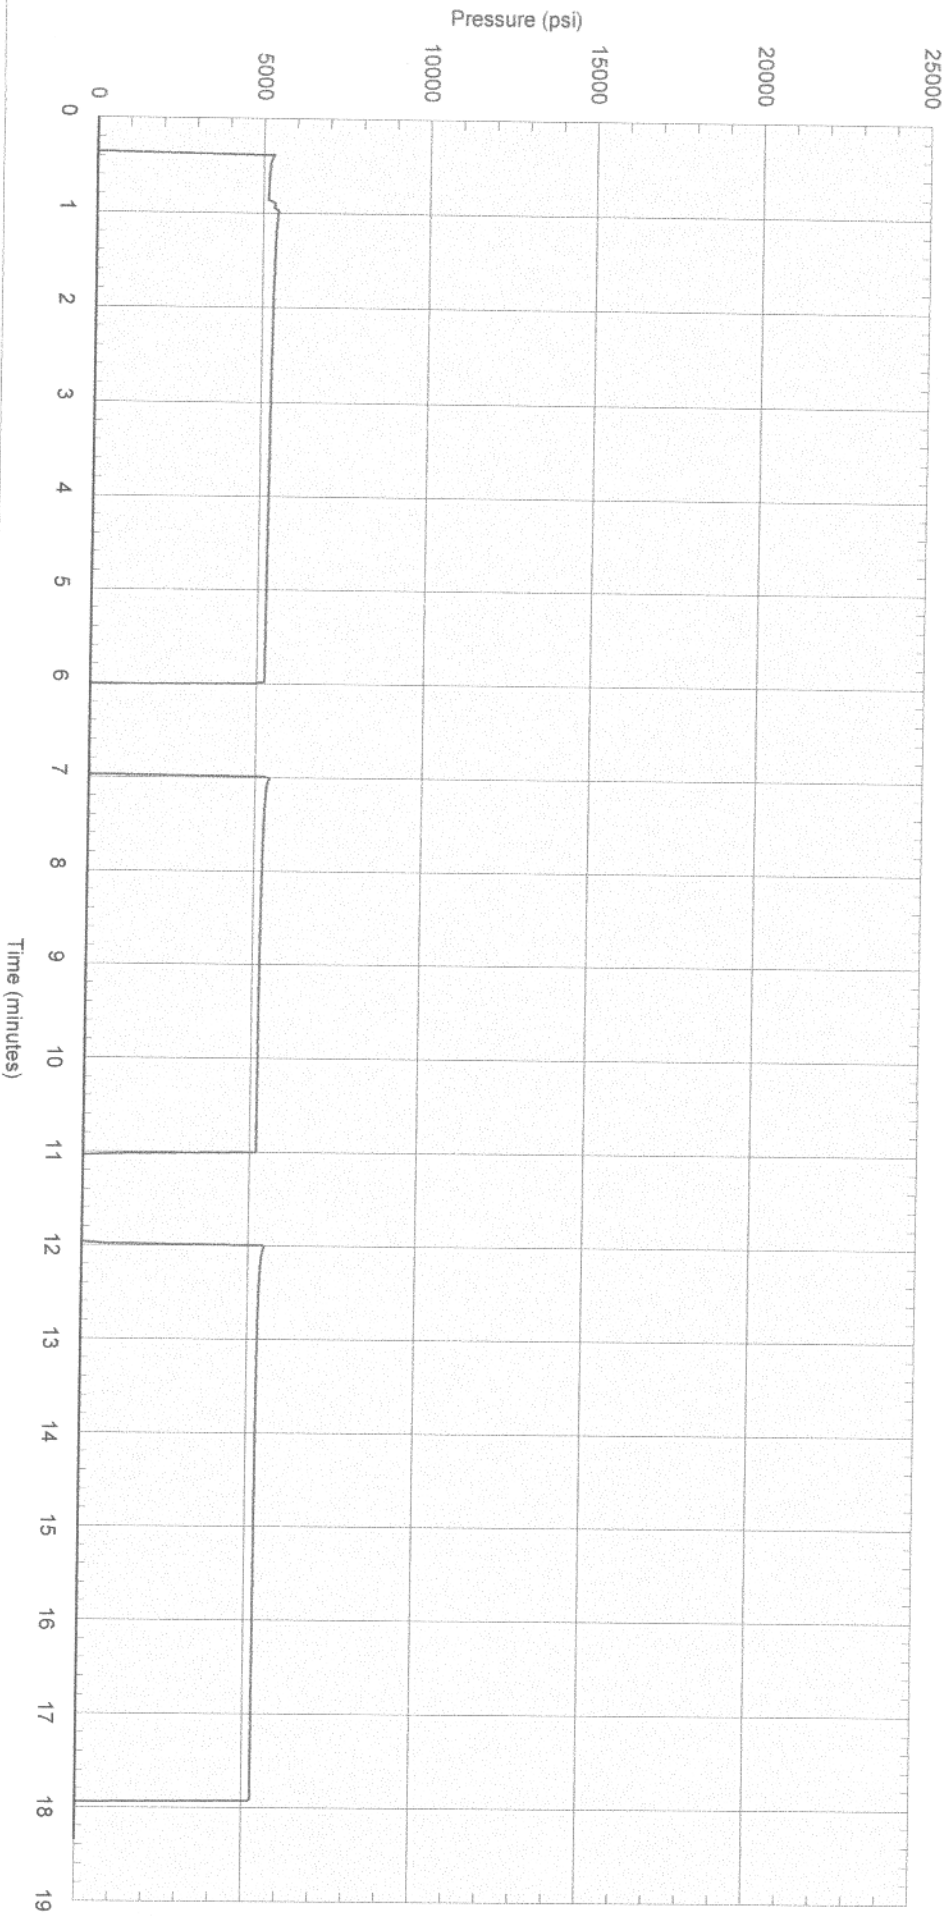

Date: November 08, 2012 03:09:12 PM
Work Order #: 81393
Serial #: CER-0404
Unit #: Chart 4
A #:
Tested By: Frank