

**D-Valves Ltd.**

6133, 97 Street

Edmonton, Alberta T0E 3J3

Phone (780) 436-5755 Fax (780) 438-7966

We certify that all inside blow-out preventers, Kellycocks and valves supplied on the work order listed below, are manufactured to meet all requirements in accordance with:

American Petroleum Institute (A.P.I.)

National Association of Corrosion Engineers (NACE) MR-01-75 specifications

Alberta Recommended Practices (A.R.P.)

All valves have been pressure tested and charted.

Customer: Viper Rentals & Services

Work Order # 62201

Serial # D28751-1197

**VRS-1895**

Date: January 7, 2008

Size: 2 7/8" Fine D Valve Safety 1BOP, NACE, 2 pc

Pressure: 5,000 PSI

Part	Number	Material	Part	Number	Material
Body & sub	D28751	1-40	SEI	D28751-B	17-4 PH
Stem	D28751-S	Monel	Stem Bore Ring	D28751-SB	17-4 PH
Upper Seal	D28751-LS	Stonox	Upper Seal	D28751-LIS	Stonox
Stem Ring	D28751-SR	17-4	Spine	PVA-1189	750X Discount


Authorized Signature:





== since 1988 ==

Caliber Energy Systems  
2 7/8" EUE D-Valve Safety IBOP  
S/N VRS-1895

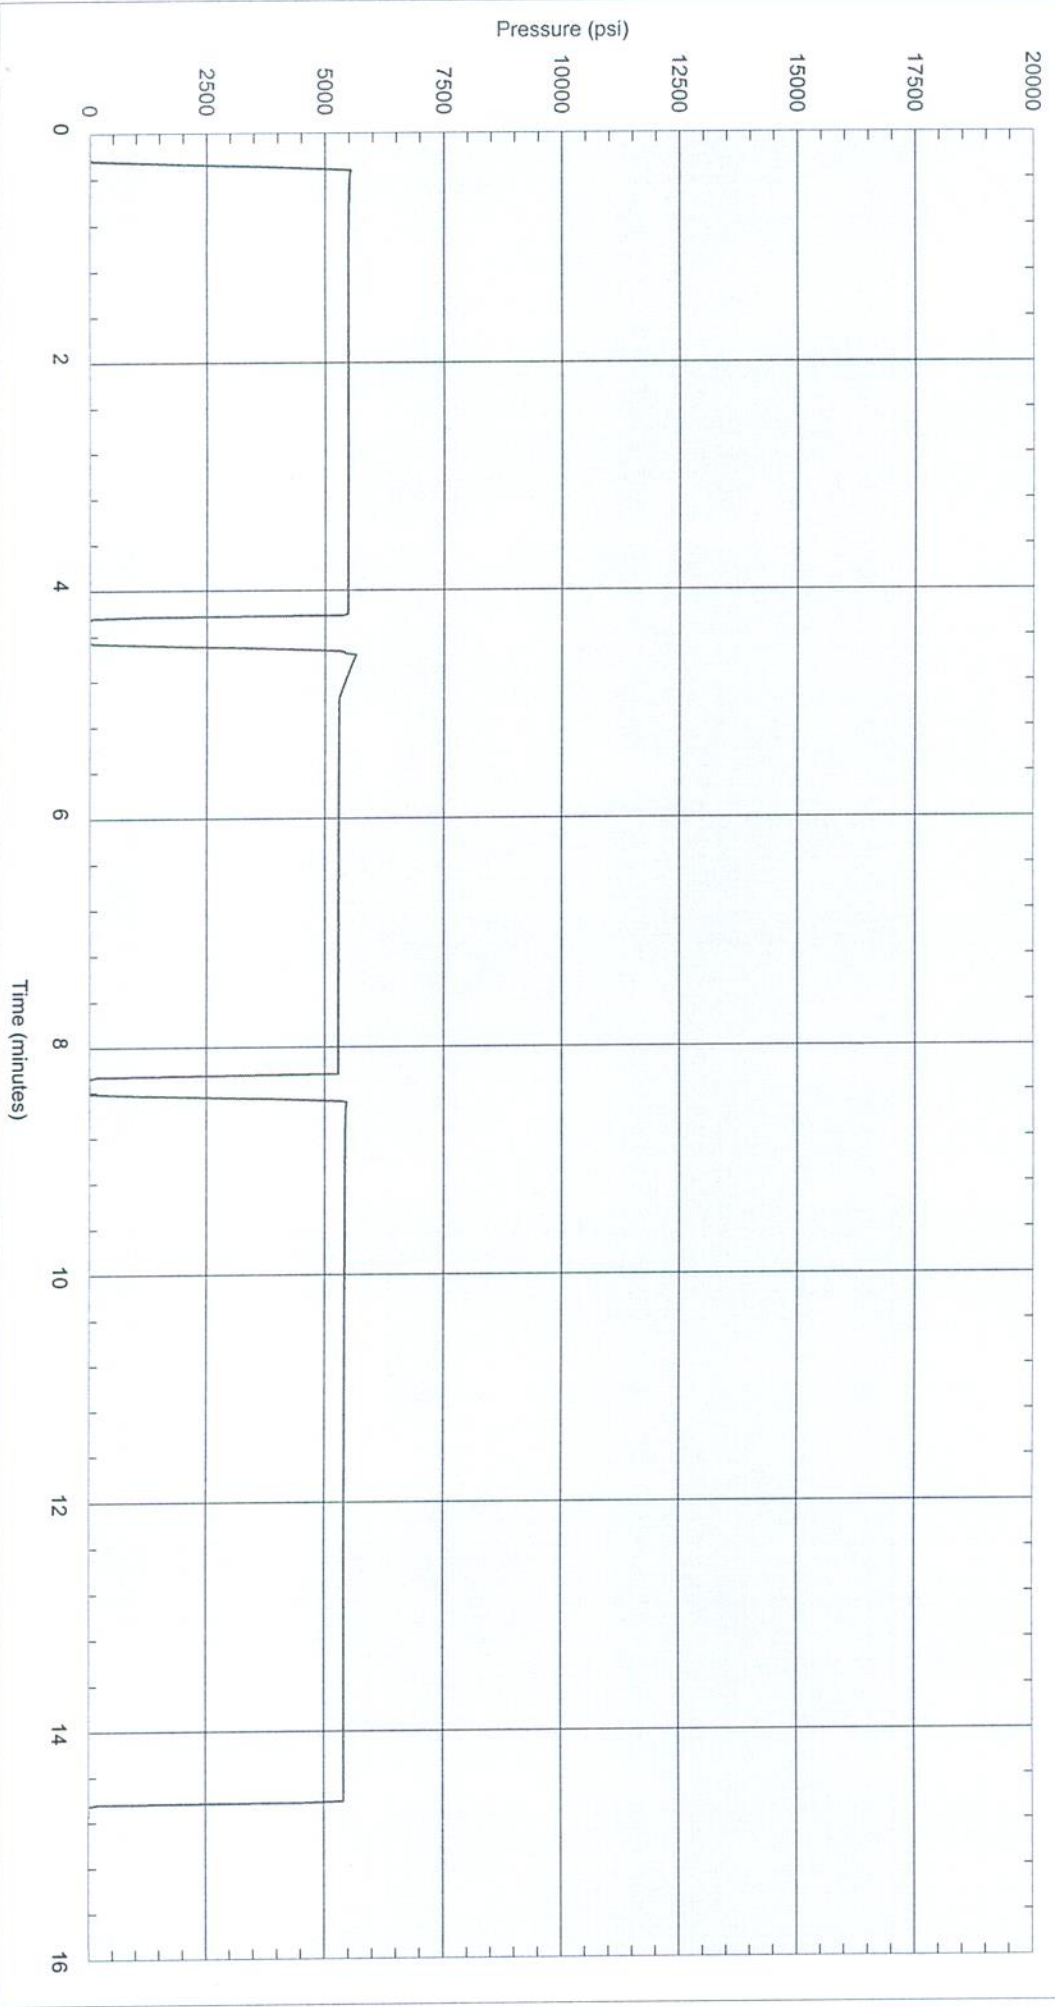

Date: March 17, 2020 11:24:48 AM  
Work Order #: 98135  
Tested By: Mark Cummings