

D-Valves Ltd.

6133 -97 Street
Edmonton, Alberta T6E 3T3
Phone (780) 436-2553 Fax (780) 438 7906

We certify that all inside blow-out preventers, Kellysacks and valves supplied on the work order listed below, are manufactured to meet all requirements in accordance with:

- American Petroleum Institute (A.P.I.)
- National Association of Corrosion Engineers (NACE) MR-01-75 specifications
- Alberta Recommended Practices (A.R.P.)

All valves have been pressure tested and charted.


Customer: Viper Rentals & Services
Work Order # 70746
Serial # D2875T 1263 VRS 1465

Date: January 29, 2010
Size: 2 3/8 (Int. D-Valve Safety, (BOP, NACL), 2 pos.
Pressure: 5,000 PSI

Part	Number	Material	Part	Number	Material
Ball	D2875H	11 10	Ball	D2875H	17-4 PH
Stem & Sub	D2875S	Stainless	Stem B, Spring	D2875SR	17-4 PH
Stem	D2875LS	Brass	Upper Seat	D2875T DS	40036
Lower Seat	D2875LR	1: 4	Spring	DVA 1189	50% Inwood
Seal Ring					

Authorized Signature: *M. Lawrence*

Caliber Energy Systems
2 7/8" EUE D-Valve Safety IBOP
S/N VRS-1965

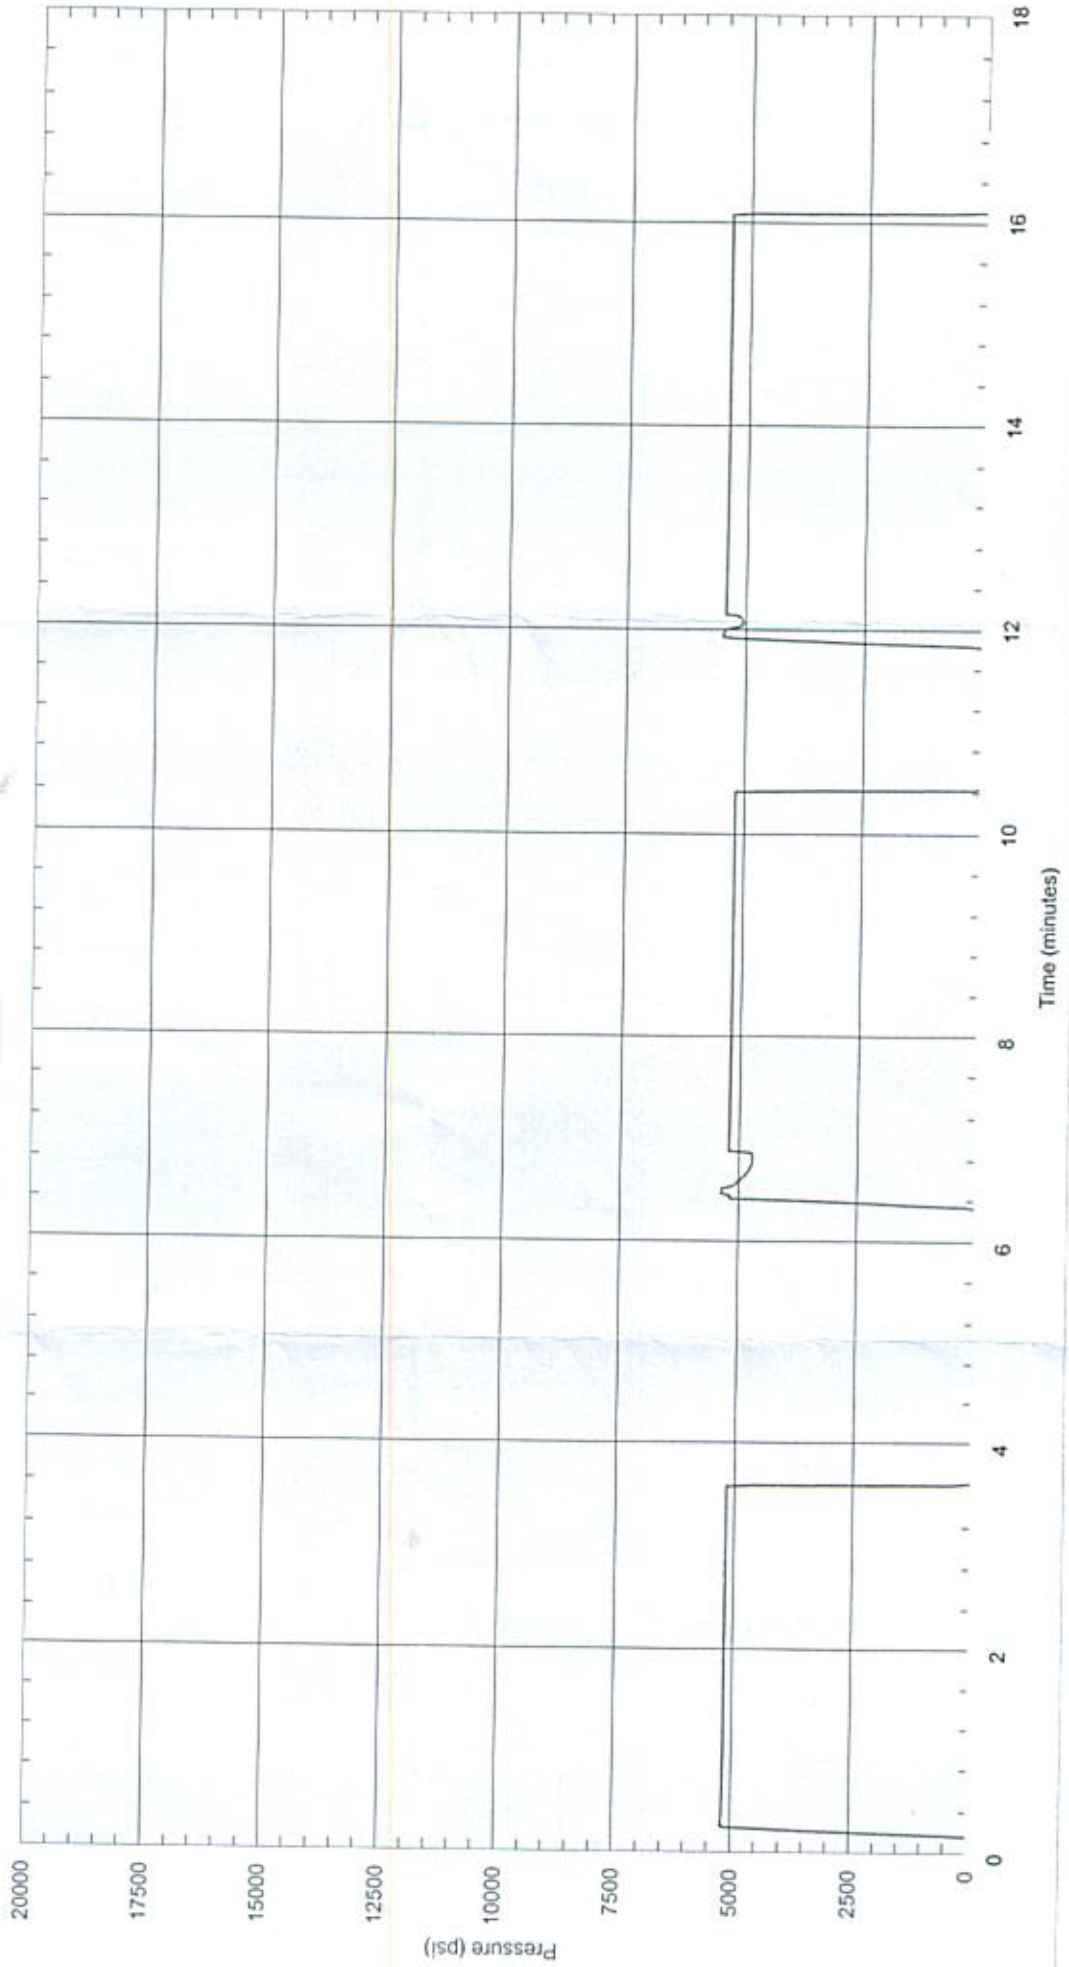

Date: April 29, 2021 01:10:01 PM
Work Order #: 99234
Tested By: Mark Cummings