



TARTAN VALVE REPAIR LTD.

## *Certificate of Compliance*

This certificate of compliance is issued  
for the products supplied by Tartan Valve Repair Ltd.  
all products meet the requirements of the purchase order  
and have been manufactured in accordance with  
**API Spec 6A- 17th Edition**  
as per information contained in our records

PRODUCTS:	1 - 2 1/16" 5000# Flanged End 'DD' NACE MR-01-75 API 6A Tartan Gate Valves, PSL 1 PR 1, (TV-25-FE-DD)
SERIAL No(s):	KL-138, KL-101
PURCHASER:	HI KALIBRE
PURCHASE ORDER No.:	037115
	April 4, 2002

Inspection and Testing of the above described product(s)  
has been performed in accordance with API Spec 6A-17th Edition

QA. Manager


Larry Bunney

Operation Manager

  
Kelly Cunningham

Tartan Valve Repair Ltd.  
4140 - 76 Avenue  
Edmonton, Alberta  
Canada  
Phone (780) 463 - 3366 FAX (780) 462 - 1670

Viper Rentals & Services  
2 1/16" Tartan Flanged Gate Valve

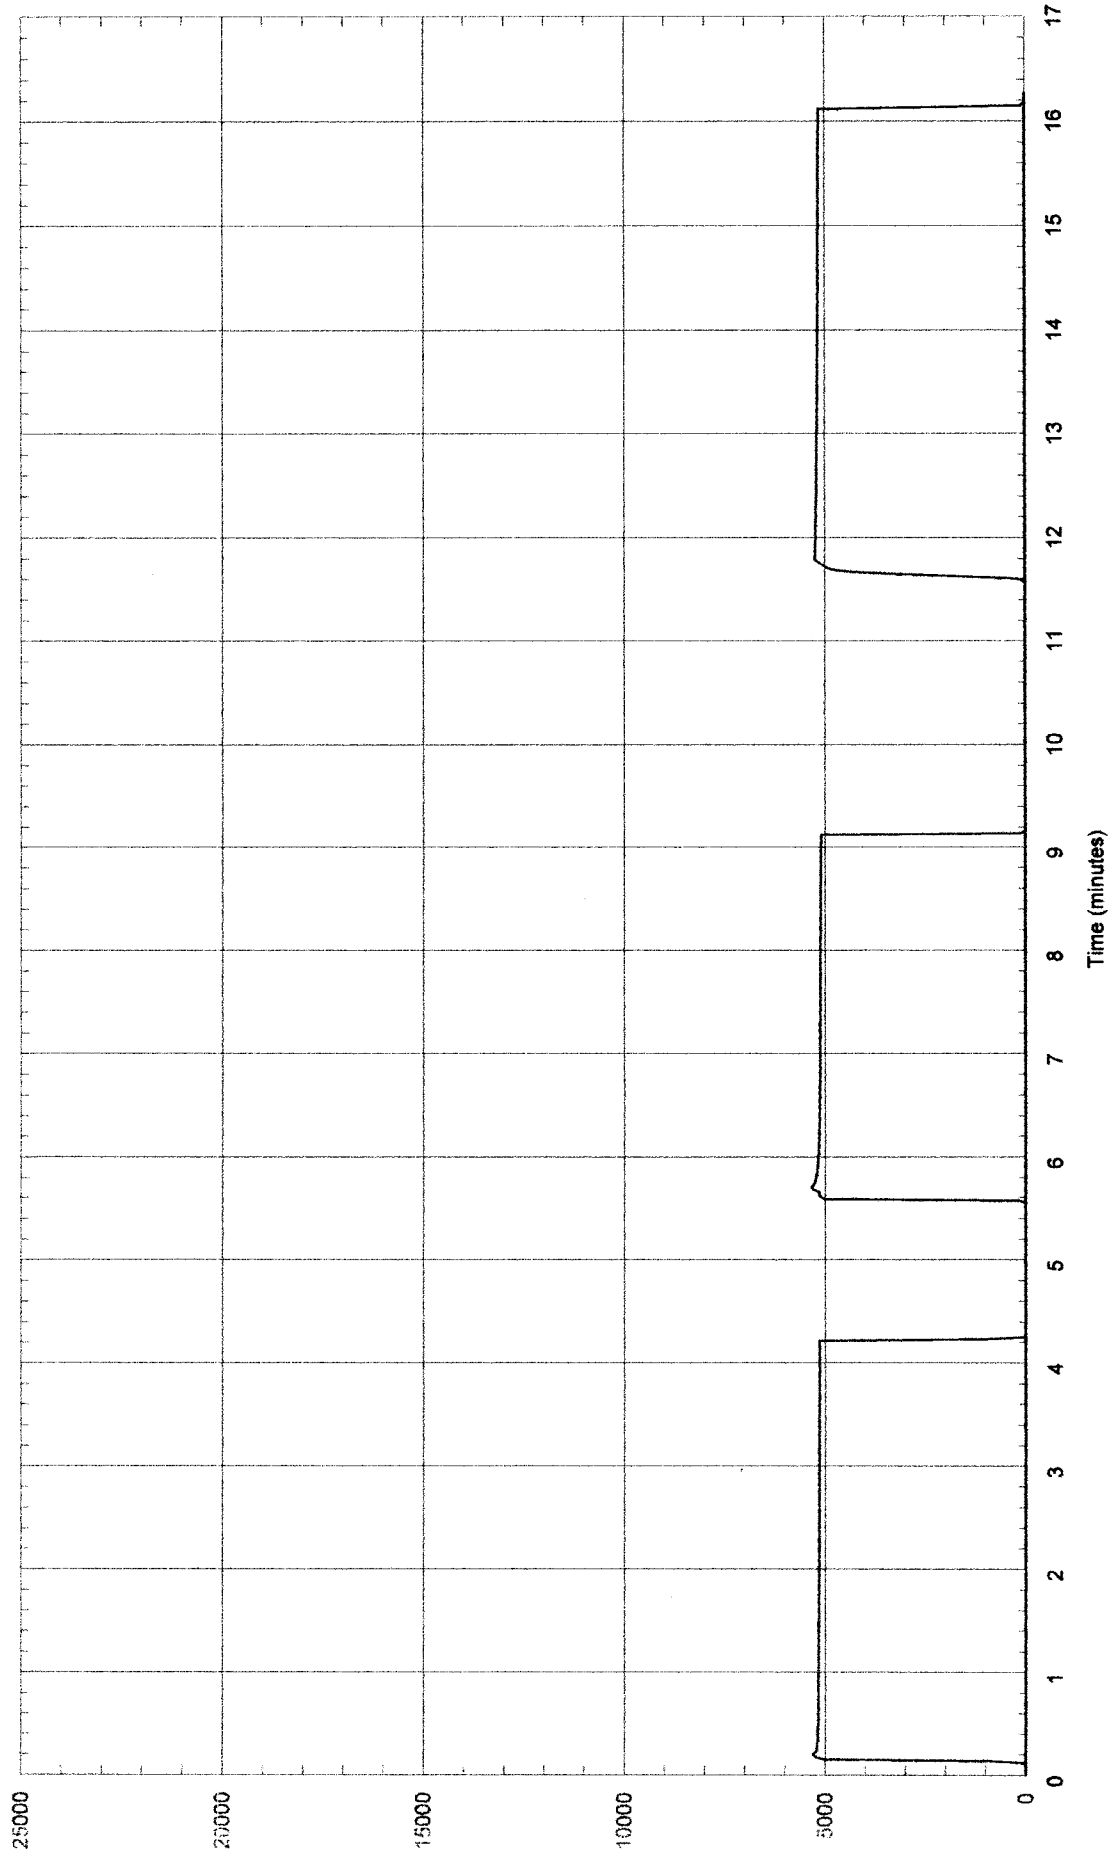

Date: July 15, 2013 10:53:37 AM  
Work Order #: 83752  
Serial #: VRS-933  
Unit #: chart4  
A.#:  
Tested By: Keith