


**Caliber Energy Systems
7 1/16" Sterom Flanged Gate Valve**

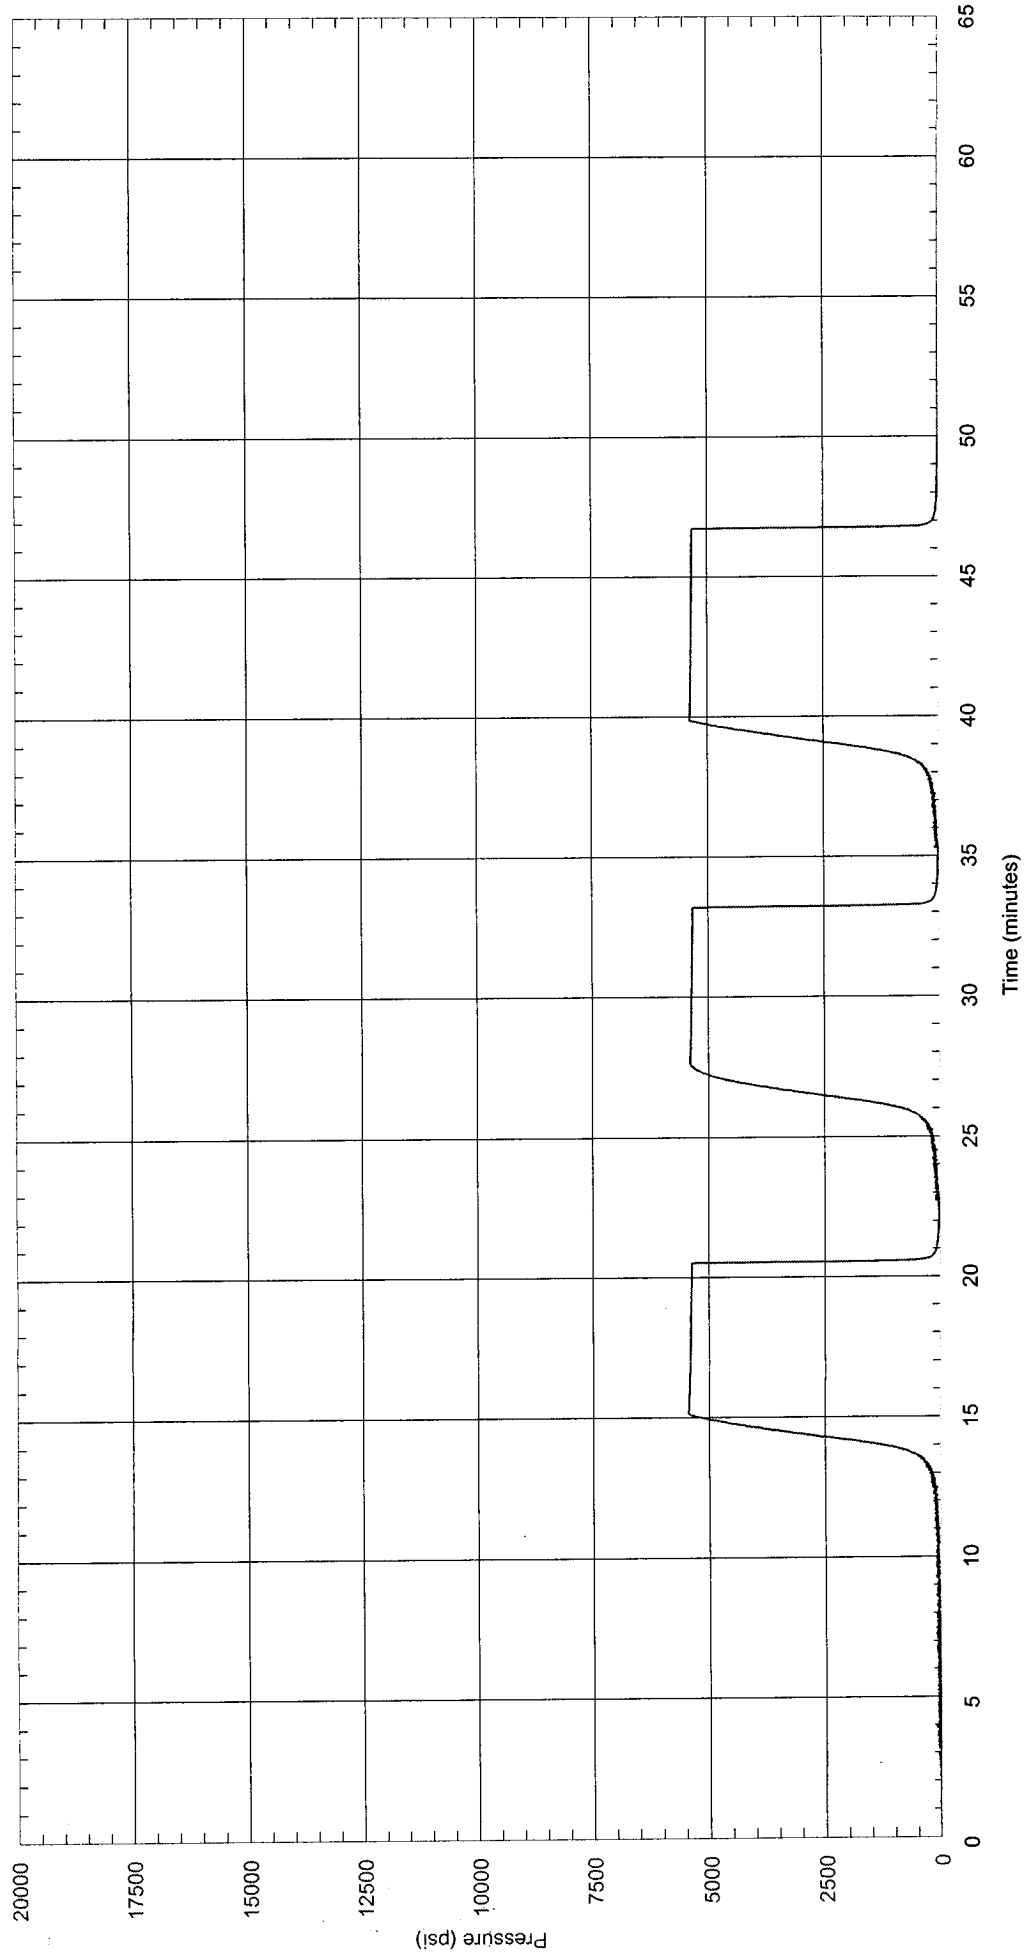

Date: April 30, 2018 12:30:50 PM
W/O 94662
S/N VRS-1817
Test Unit:
Tested By: Mark Cummings