


**Caliber Energy Systems
2 9/16" 5000 Omni Threaded Gate Valve
S/N: 950547 // CER-0427**

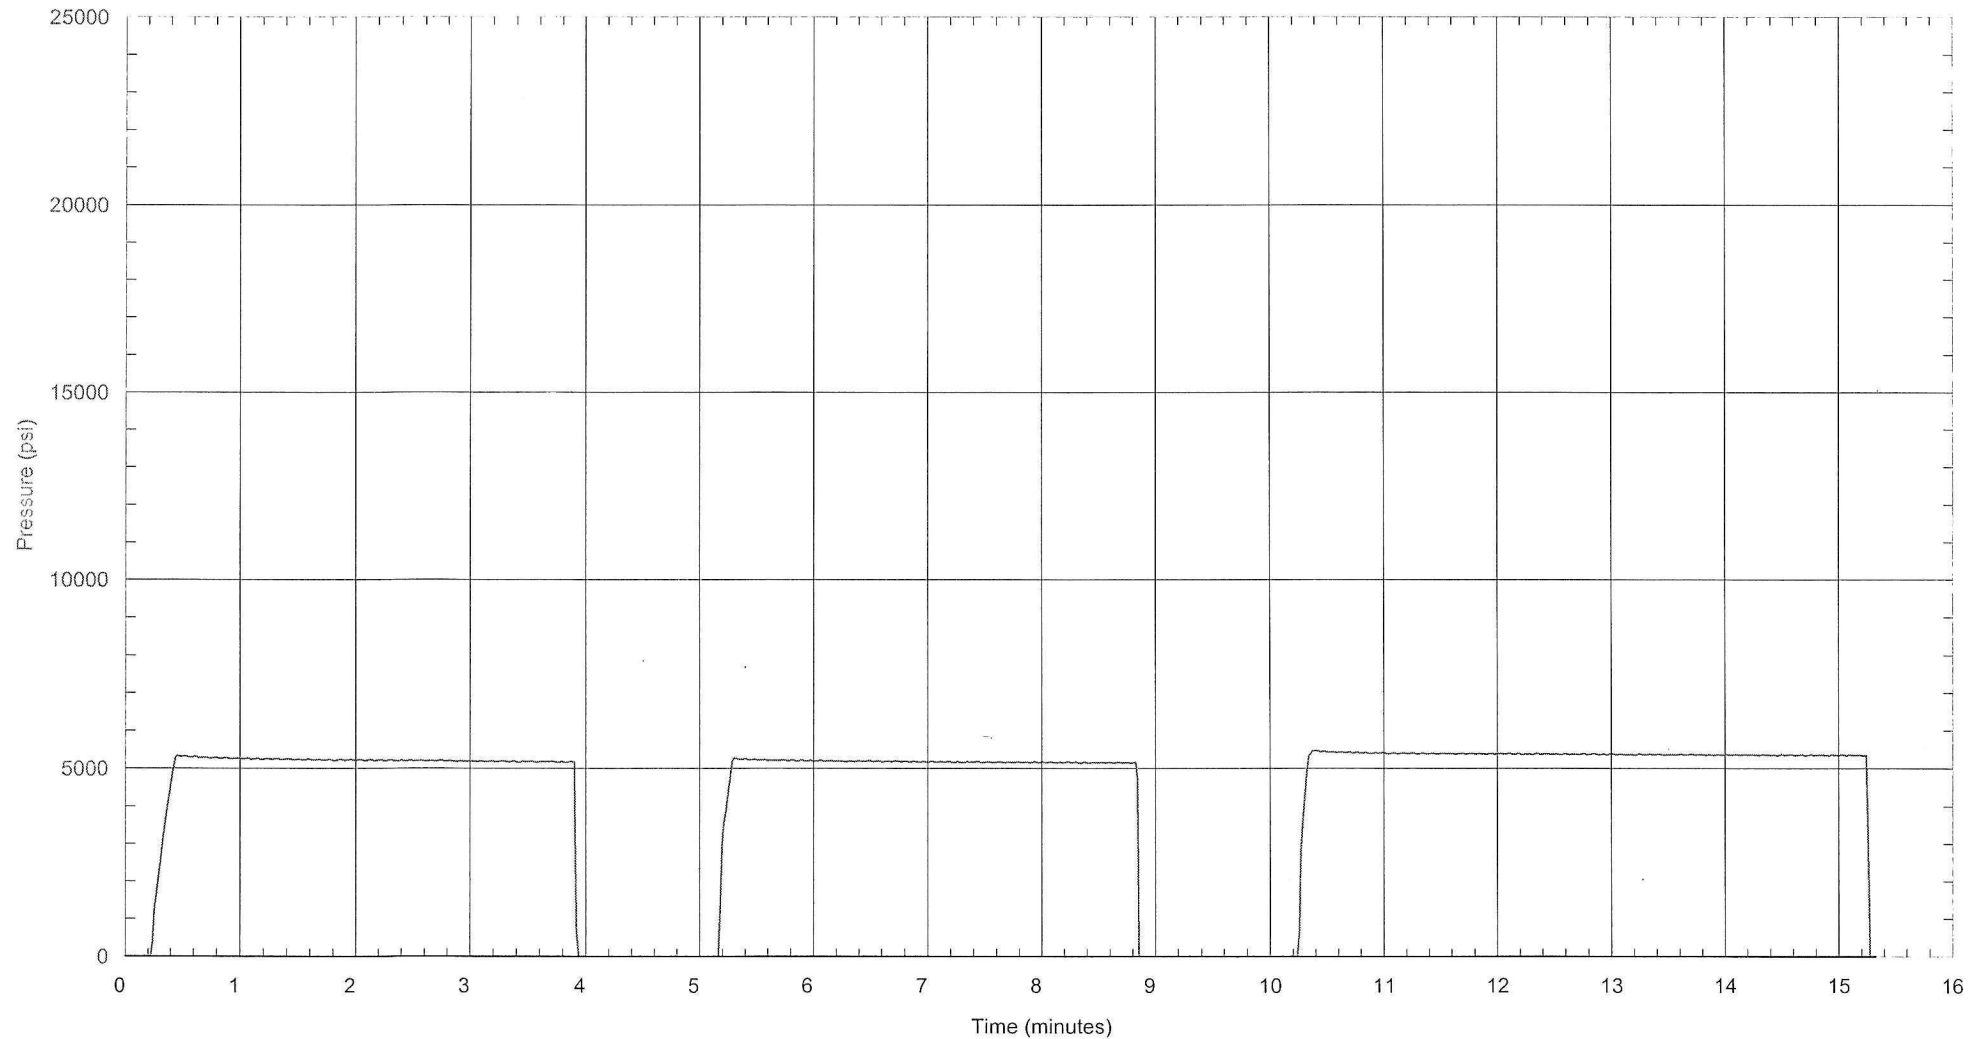

Date: May 29, 2023 09:00:10 AM
Work Order #: 102370
Tested By: Keith McIsaac

D-Valves Ltd.

6133 -97 St.

Edmonton, Alberta T6E 3J3

Phone (780) 436-5353 Fax (780) 436-7653

We certify that all inside blow-out preventers, kellycocks and valves supplied on the work order listed below, are manufactured to meet all requirements in accordance with :

American Petroleum Institute (A.P.I.)

National Association of Corrosion Engineers (NACE) MR-01-75 specifications

Alberta Recommended Practices (A.R.P.)

All valves have been pressure tested and charted.

Customer: Caliber Energy Services

Work Order # 102370

Serial # 950547

CER-0427

Date: May 29, 2023

Size: 2 ⁹/₁₆ Omni Threaded Gate Valve

Pressure: 5,000 PSI

<u>Part</u>	<u>Number</u>	<u>Part</u>	<u>Number</u>
Body	See Letter of Compliance	Bonnet	See Letter of Compliance
Gate	See Letter of Compliance	Gate Segment	See Letter of Compliance
Seat	See Letter of Compliance	Seat	See Letter of Compliance
Stem	See Letter of Compliance		

Authorized Signature: _____

